


SINGLE COLLECTOR, SID PUMP, 20 W PV IMMERSED HE TANK, 3 WAY BYPASS PRESSURIZED WATER/ GLYCOL HTF	4/05 RO JD
--	---------------

R-90, S=1-9, X=5, Y=15 © 2005 BTF Solar Ltd

installation as per Michigan Mechanical Code and NEC

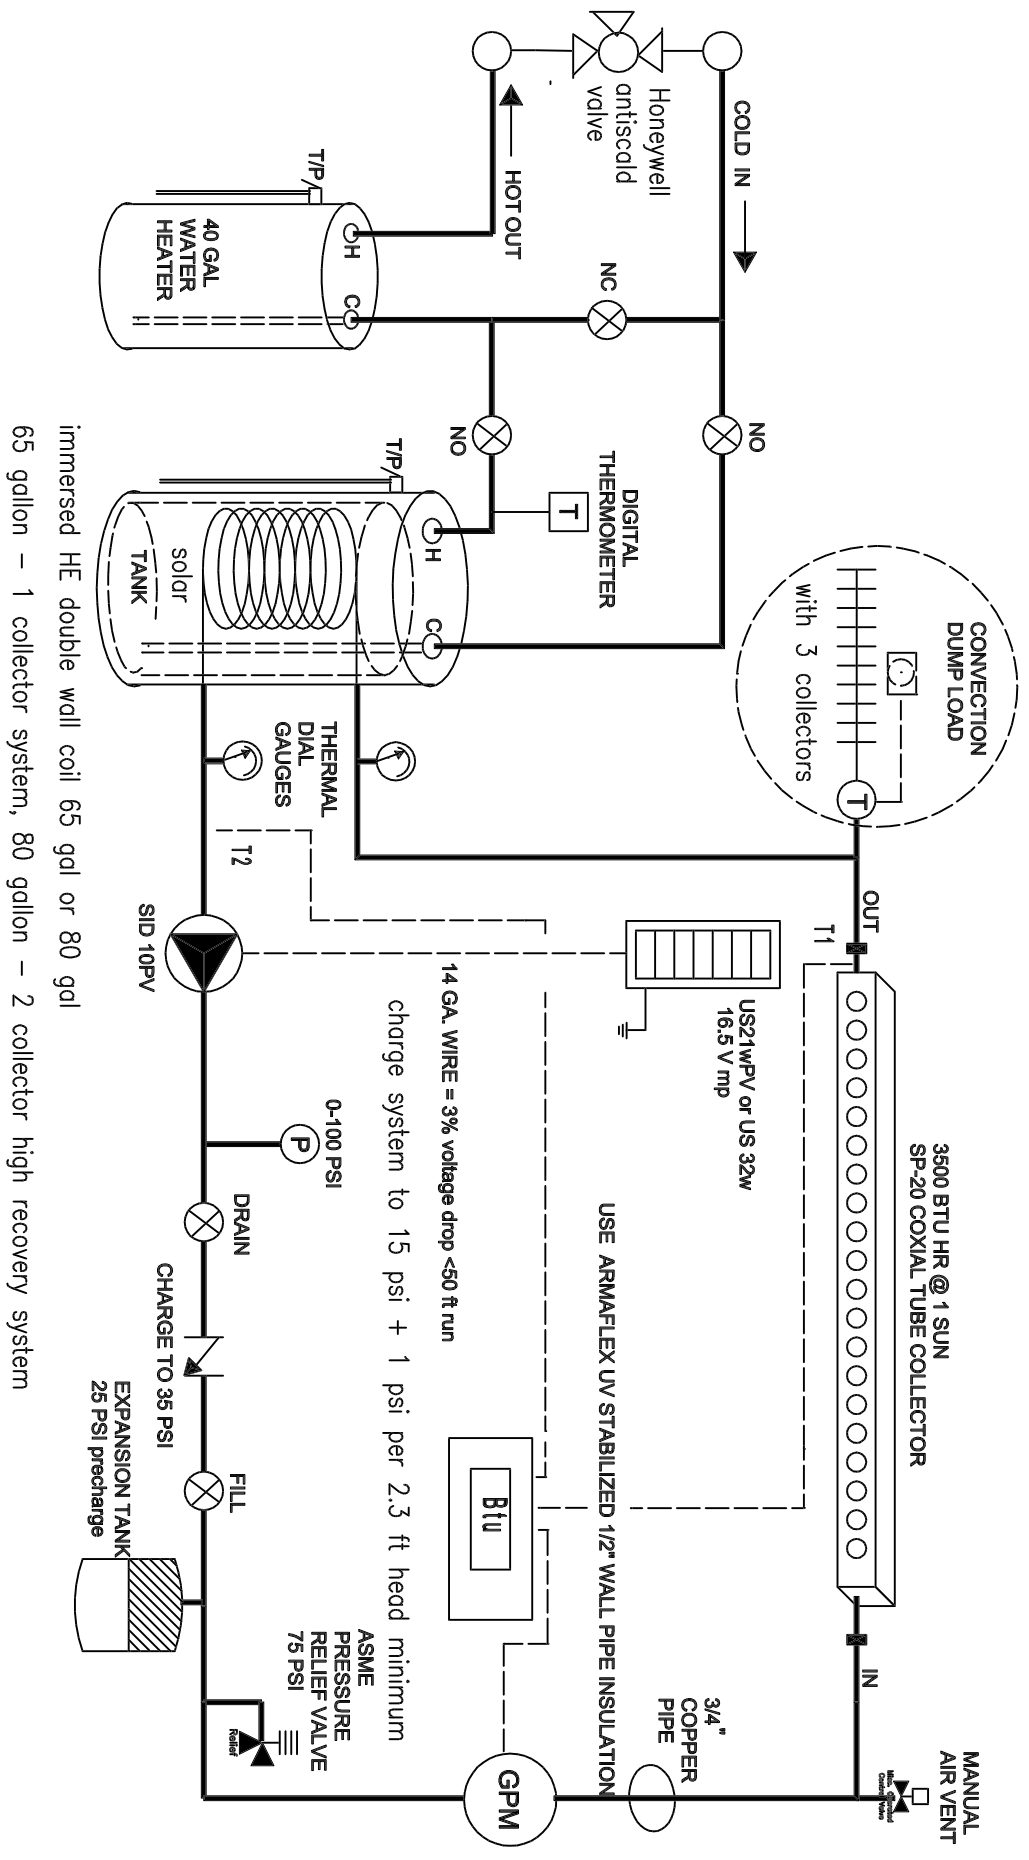

immersed HE double wall coil 65 gal or 80 gal
65 gallon — 1 collector system, 80 gallon — 2 collector high recovery system